

BU600E/BU1000E User's Manual

K01-C000065-00

IMPORTANT SAFETY INSTRUCTIONS

(SAVE THESE INSTRUCTIONS)

This manual contains important safety instructions. Please read and follow all instructions carefully during installation and operation of the unit. Read this manual thoroughly before attempting to unpack, install, or operate your UPS.

CAUTION! To prevent the risk of fire or electric shock, install in a temperature and humidity controlled indoor area free of conductive contaminants. (See the specifications for the acceptable temperature and humidity range.)

CAUTION! To reduce the risk of overheating the UPS, do not cover the UPS' cooling vents and avoid exposing the unit to direct sunlight or installing the unit near heat emitting appliances such as space heaters or furnaces.

CAUTION! Do not attach non-computer-related items, such as medical equipment, life-support equipment, microwave ovens, or vacuum cleaners to UPS.

CAUTION! Do not plug the UPS input into its own output.

CAUTION! Do not allow liquids or any foreign object to enter the UPS. Do not place beverages or any other liquid-containing vessels on or near the unit.

CAUTION! In the event of an emergency, press the OFF button and disconnect the power cord from the AC power supply to properly disable the UPS.

CAUTION! Do not attach a power strip or surge suppressor to the UPS.

CAUTION! Unplug the UPS prior to cleaning and do not use liquid or spray detergent.

CAUTION! Servicing of batteries should be performed or supervised by personnel knowledgeable of batteries and the required precautions. Keep unauthorized personnel away from batteries.

CAUTION! The battery supply should be therefore disconnected in the plus and minus pole at the quick connectors of the battery when maintenance or service work inside the UPS is necessary.

CAUTION! Internal battery voltage is 12Vdc. Sealed, lead-acid, 6-cell battery.

CAUTION! When replacing the batteries, use the same number and type of batteries.

CAUTION! Do not dispose of batteries in a fire. The battery may explode. Do not open or mutilate the battery or batteries. Released electrolyte is harmful to the skin and eyes.

INSTALLING YOUR UPS SYSTEM

UNPACKING


The box should contain the following: (1) UPS Unit x1; (2) Quick Start Guide x1; (3) User Manual x1.

OVERVIEW

The BU600E/BU1000E provides automatic voltage regulation for inconsistent utility power, and provides battery backup during power outages. The BU600E/BU1000E ensures consistent power to your computer system.

HARDWARE INSTALLATION GUIDE

- 1. Your new UPS may be used immediately upon receipt. However, recharging the battery for at least 8 hours is recommended to ensure that the battery's maximum charge capacity is achieved. Charge loss may occur during shipping and storage. To recharge the battery, simply leave the unit plugged into an AC outlet. The unit will charge in both the on and off position.
- With the UPS unit off and unplugged, connect the computer, monitor, and any externally powered data storage device (Zip drive, Jazz drive, Tape drive, etc. into the battery power supplied outlets. DO NOT plug a laser printer, copier, space heater, vacuum, paper shredder or other large electrical device into the battery power supplied outlets. The power demands of these devices will overload and possibly damage the unit.
- 3. Plug the UPS into a 2 pole, 3 wire grounded receptacle (wall outlet). Make sure the wall branch outlet is protected by a fuse or circuit breaker and does not service equipment with large electrical demands (e.g. air conditioner, refrigerator, copier, etc. Avoid using extension cords.
- 4. Press the power switch to turn the unit on. The power on indicator light will illuminate and the unit will "beep".
- 5. If an overload is detected, an audible alarm will sound and the unit will emit one long beep. To correct this, turn the UPS off and unplug at least one piece of equipment from the battery power supplied outlets. Wait 10 seconds. Make sure the circuit breaker / fuse is normal and then turns the UPS on.
- 6. To maintain optimal battery charge, leave the UPS plugged into an AC outlet at all times.
- 7. To store your UPS for an extended period, cover it and store with the battery fully charged. Recharge the battery every three months to ensure battery life.

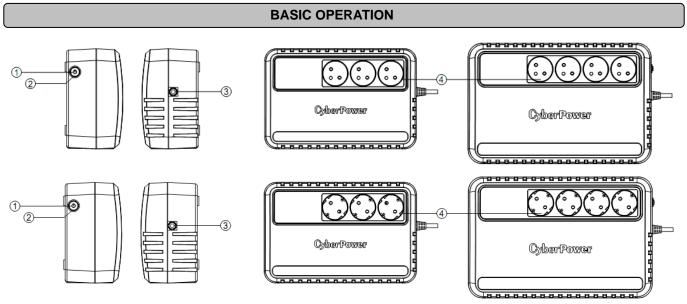

1. Power Switch

Press the switch for 2 seconds to turn the UPS ON or OFF.

Alarm setting: The audible alarm can be turned OFF or ON by quickly pressing the POWER button twice. The default setting is for the Alarm On. To turn the Alarm Off, quickly press the power button twice. You will hear two short beeps when the Alarm is turned off. To turn the Alarm back on, quickly press the power button twice. You will hear a single short beep when the Alarm is turned on.

2. Led Indicators

This LED is illuminated when the UPS is working.

3. Input Power Cord

Connect to utility power.

4. AC outlet

The UPS provides outlets for connected equipment to insure temporary uninterrupted operation during a power failure and against surges and spikes.

TECHNICAL SPECIFICATIONS

Model	BU600E	BU1000E	
Capacity (VA)	600	1000	
Watt (W)	360	600	
Input			
Voltage Range	165~280Vac		
Nominal Frequency	50 Hz		
Output			
On Battery Output Voltage	Simulated Sine Wave at 220Vac +/-5%		
On Battery Output Frequency	50 Hz +/-1%		
Overload Protection	Breaker / Fuse		
Physical			
Total # of UPS Receptacles	3	4	
Dimensions (H x W x D)(mm)	91.5 x 158 x 240	110.5 x 190 x 290	
Weight	3.8 kg	6.9 kg	
Battery			
Sealed Maintenance Free Lead Acid	RBP0043 x1	RBP0046 x2	
Battery			
Typical Recharge Time	8 Hours		
Warning Diagnostics Indicators			
	Power On / Using Battery		
Audible Alarms Environmental	On Battery, Low Battery, Overload, Fault		
	000	1000	
Operating Temperature	0°C to 40°C		
Operating Relative Humidity	0 to 90%		
Management			
Auto-Charger	Yes		
Auto-Restart	Yes		

DEFINITIONS FOR ILLUMINATED LED INDICATORS

O LED	∢ ∜∬ Alarm	Condition	
On	Off	Normal	
Flash	Beep Twice	Utility Failure - The UPS is providing battery power to outlets.	
Flash	Rapid Beeping	Utility Failure - The UPS is providing battery power. The rapid beeps indicate the battery will run out of power shortly.	
On/Flash	Constant Tone	Overload - Occurs when connected equipment exceeds the rating of the unit. Turn the UPS off and unplug at least one piece of equipment from the UPS.	

TROUBLESHOOTING

Problem	Possible Cause	Solution
The UPS does not perform expected runtime.	Dottorios are not fully charged	Recharge the battery by leaving the
	Batteries are not fully charged.	UPS plugged in.
	Datter is alighthouse and	Contact CyberPower Systems
	Battery is slightly worn out.	Technical Support.
	The unit is not connected to an AC	The unit must be connected to a
The UPS will not turn on.	outlet.	220-240V outlet.
		Contact CuberPower Systems
	The battery is worn out.	Contact CyberPower Systems
		Technical Support.
	Mechanical problem.	Contact CyberPower Systems
		Technical Support.
Outlets do not provide power to equipment		Turn the UPS off and unplug at least
		one piece connected equipment.
		Unplug the power cord of the UPS then
	Fuse is blown or breaker is tripped	replace the blown fuse with a spare
	due to overload.	one or press the circuit breaker knob.
		Connect power cord then turn the UPS
		on. Make sure that your spare fuse
		meets the specification.
	Detteries are discharged	Allow the unit to recharge for at least 4
	Batteries are discharged	hours.
	Unit has been damaged by a surge or	Contact CyberPower Systems
	spike.	Technical Support.

For more information, visit www.cpsww.com
All rights reserved. Reproduction without permission is prohibited.







